


Fire Alarm Panel CF3000/2000 (COOPER) to VAS-CU connecting diagram via modules CIO351.

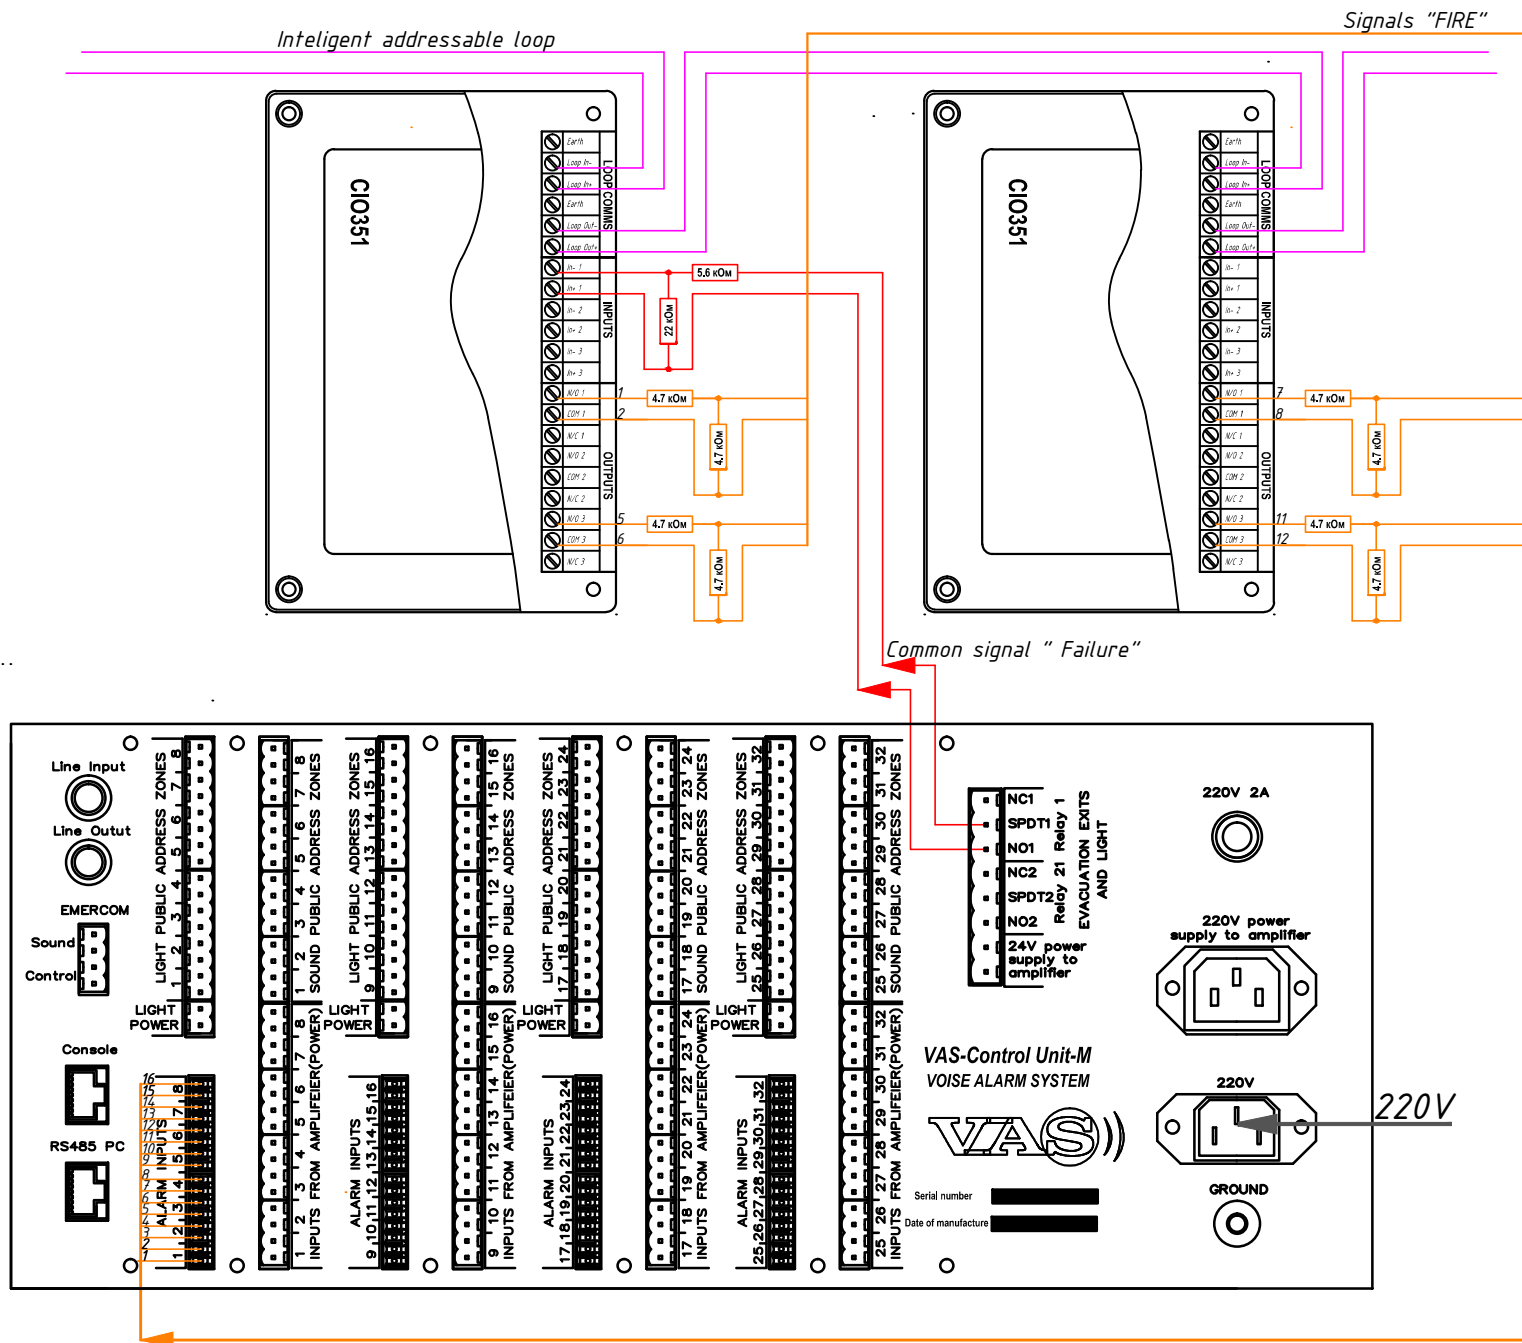

To connect VAS-CU of small and middle capacity (16 zones less) to Fire Alarm Panel CF3000/2000 (COOPER) should be used three channel input-output modules CIO351, connected to the intelligent addressable loop of CF3000/2000 panel. Common signal from the VAS-CU output using to control VAS status. It comes to controllable CIO351 module input. Address set up of the CIO351 module as well as it work algorithm setting performs on the step of programming of the CF3000/2000 control panel.