


Fire Alarm Panel ZX series and DX Connexion (MORLEY-IAS) to VAS-CU connecting diagram via 6 relay control module CR-6 and single input monitor module M-210E.

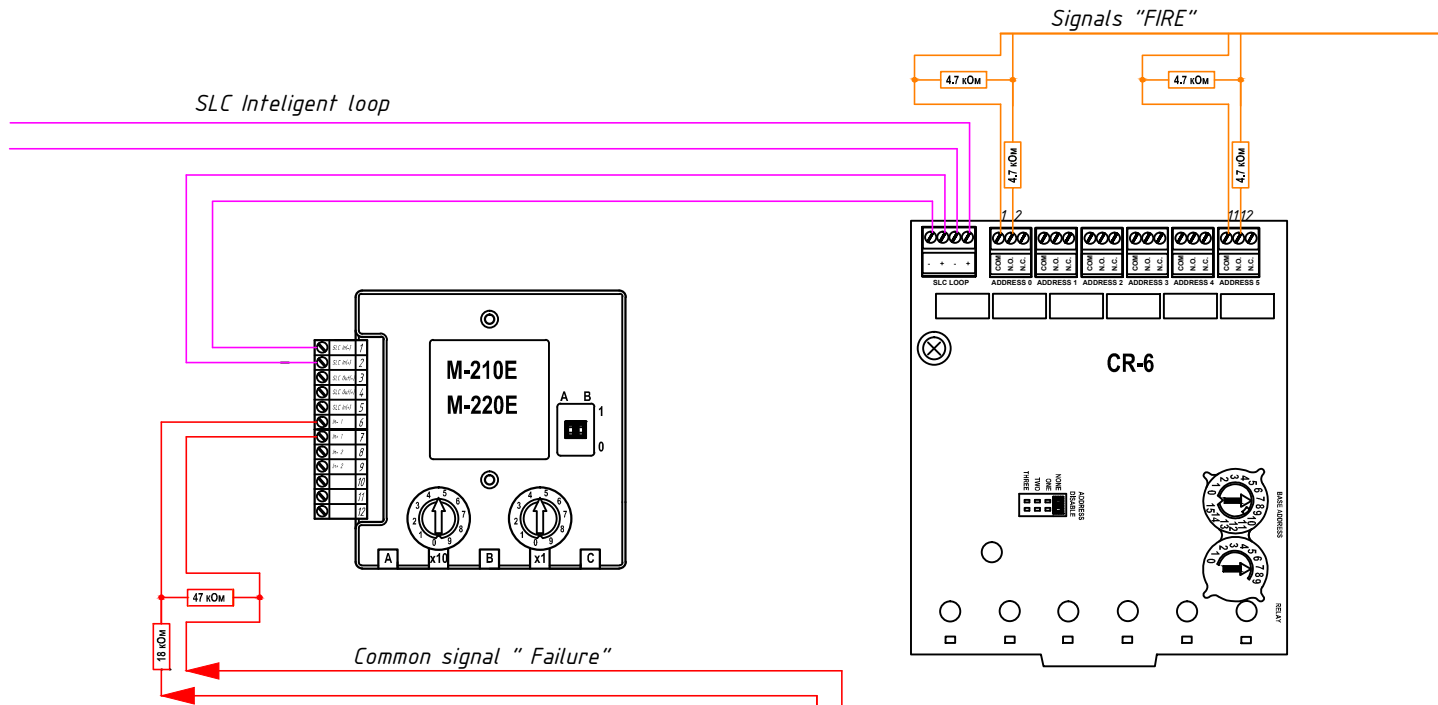

To connect VAS-CU to Fire Alarm Panels ZX series and DX Connexion (MORLEY-IAS) should be used 6 relay control module CR-6 and single input monitor module M-210E. Connect 6 relay control module CR-6 and single input monitor module M-210E to the Signaling Line Circuit(SLC) intelligent loop of Fire Alarm Panel ZX series and DX Connexion .

To monitor the status of VAS using common signal "Failure" from VAS-CU output. It comes to single input monitor module M-210E. It evaluates condition of VAS and sends the information to SLC intelligent loop.

Setting up the addresses of 6 relay control module and single input monitor module performs with switches, located on modules itself . 6 relay control modules work algorithm programming performs with Fire Alarm Panels ZX series and DX Connexion software.

